



SLAB ON GRADE FOUNDATION

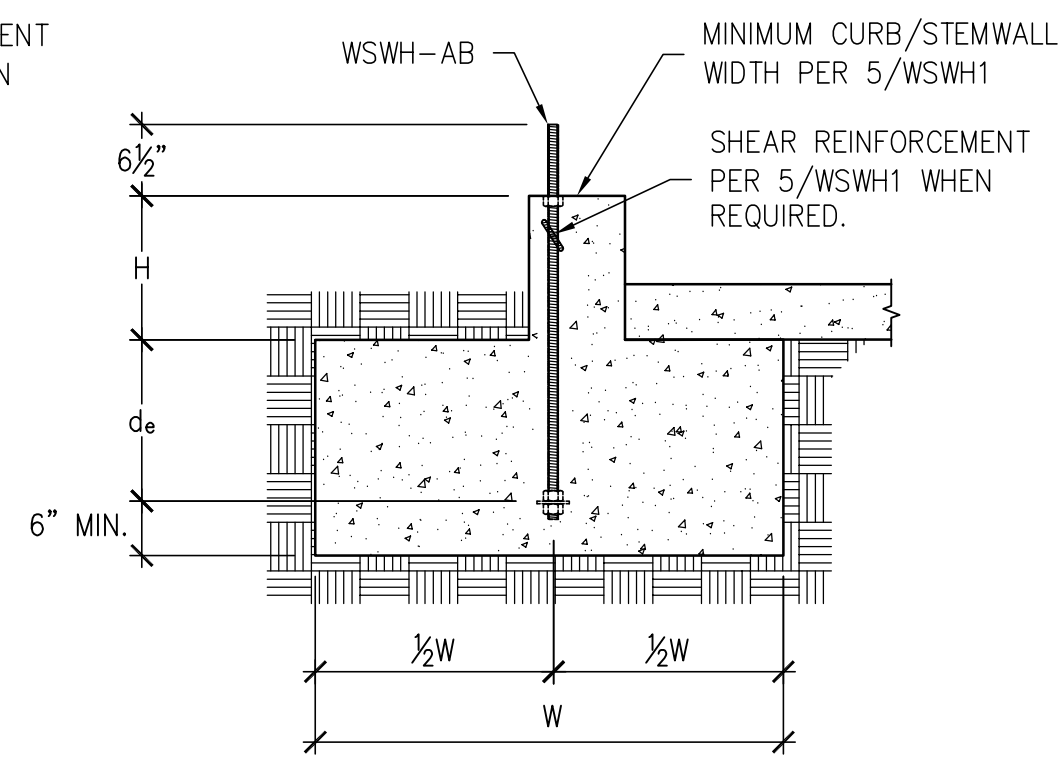


CURB OR STEMWALL FOUNDATION

- NOTES:
- SEE 2/WSWH1 FOR DIMENSIONS AND ADDITIONAL NOTES.
  - SEE 5/WSWH1 FOR SHEAR REINFORCEMENT WHEN REQUIRED.
  - MAXIMUM H =  $l_e - d_e$ . SEE 3/WSWH1 AND 4/WSWH1 FOR  $l_e$ .


DESIGNER IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.

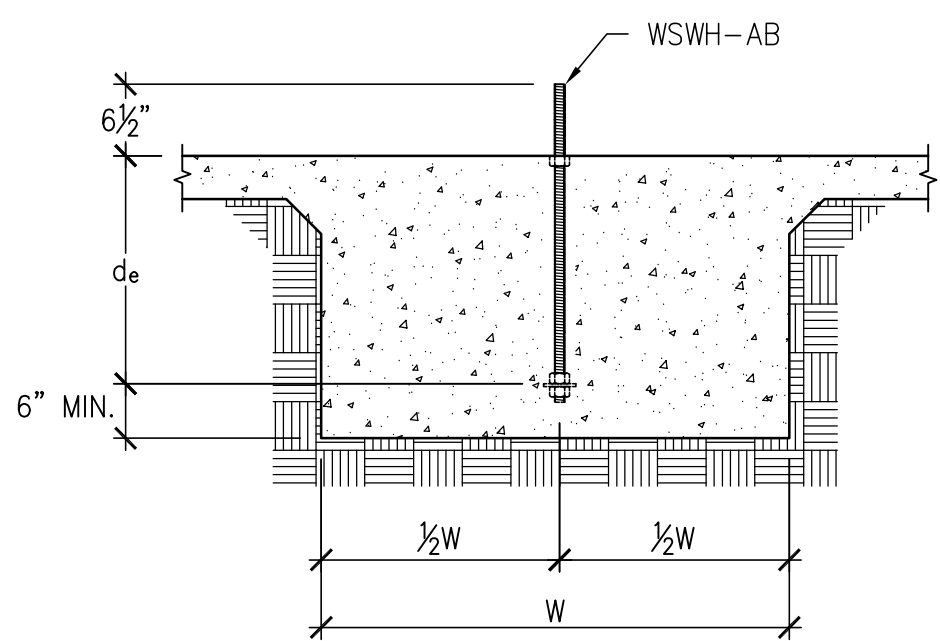


INTERIOR FOUNDATION

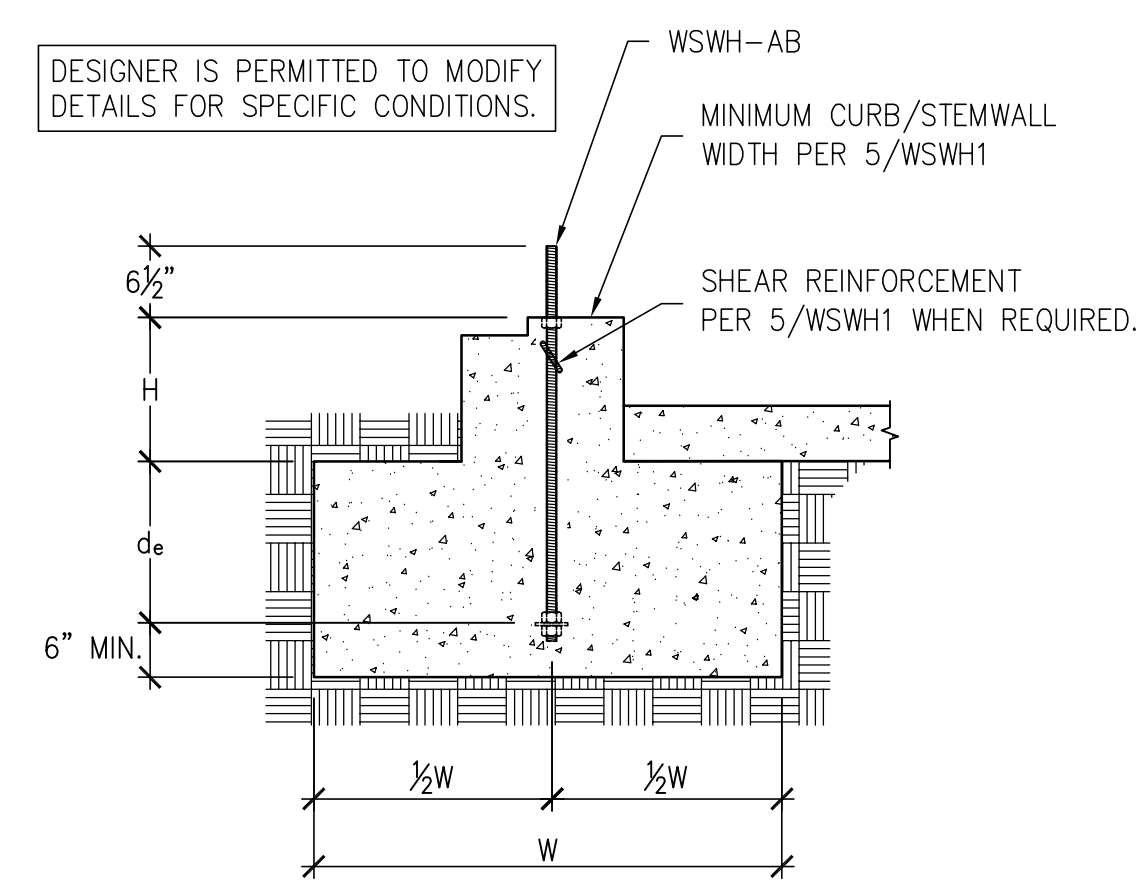

BRICK LEDGE FOUNDATION

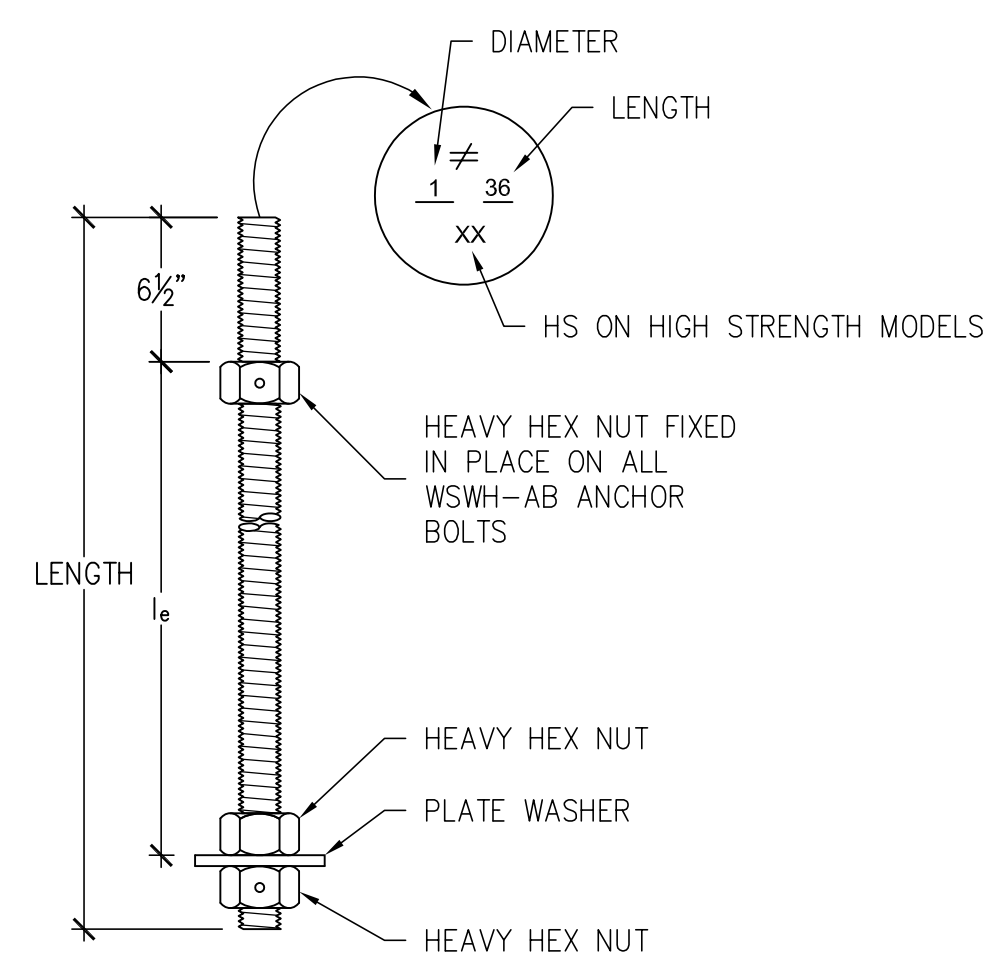


WSWH PANEL MODEL	MODEL NO.	DIAMETER	LENGTH	$l_e$
WSWH12, WSWH18 AND WSWH24	WSWH-AB1x24	1"	24"	15 1/2"
	WSWH-AB1x24HS	1"	24"	15 1/2"
	WSWH-AB1x30	1"	30"	21 1/2"
	WSWH-AB1x30HS	1"	30"	21 1/2"
	WSWH-AB1x36	1"	36"	27 1/2"
	WSWH-AB1x36HS	1"	36"	27 1/2"


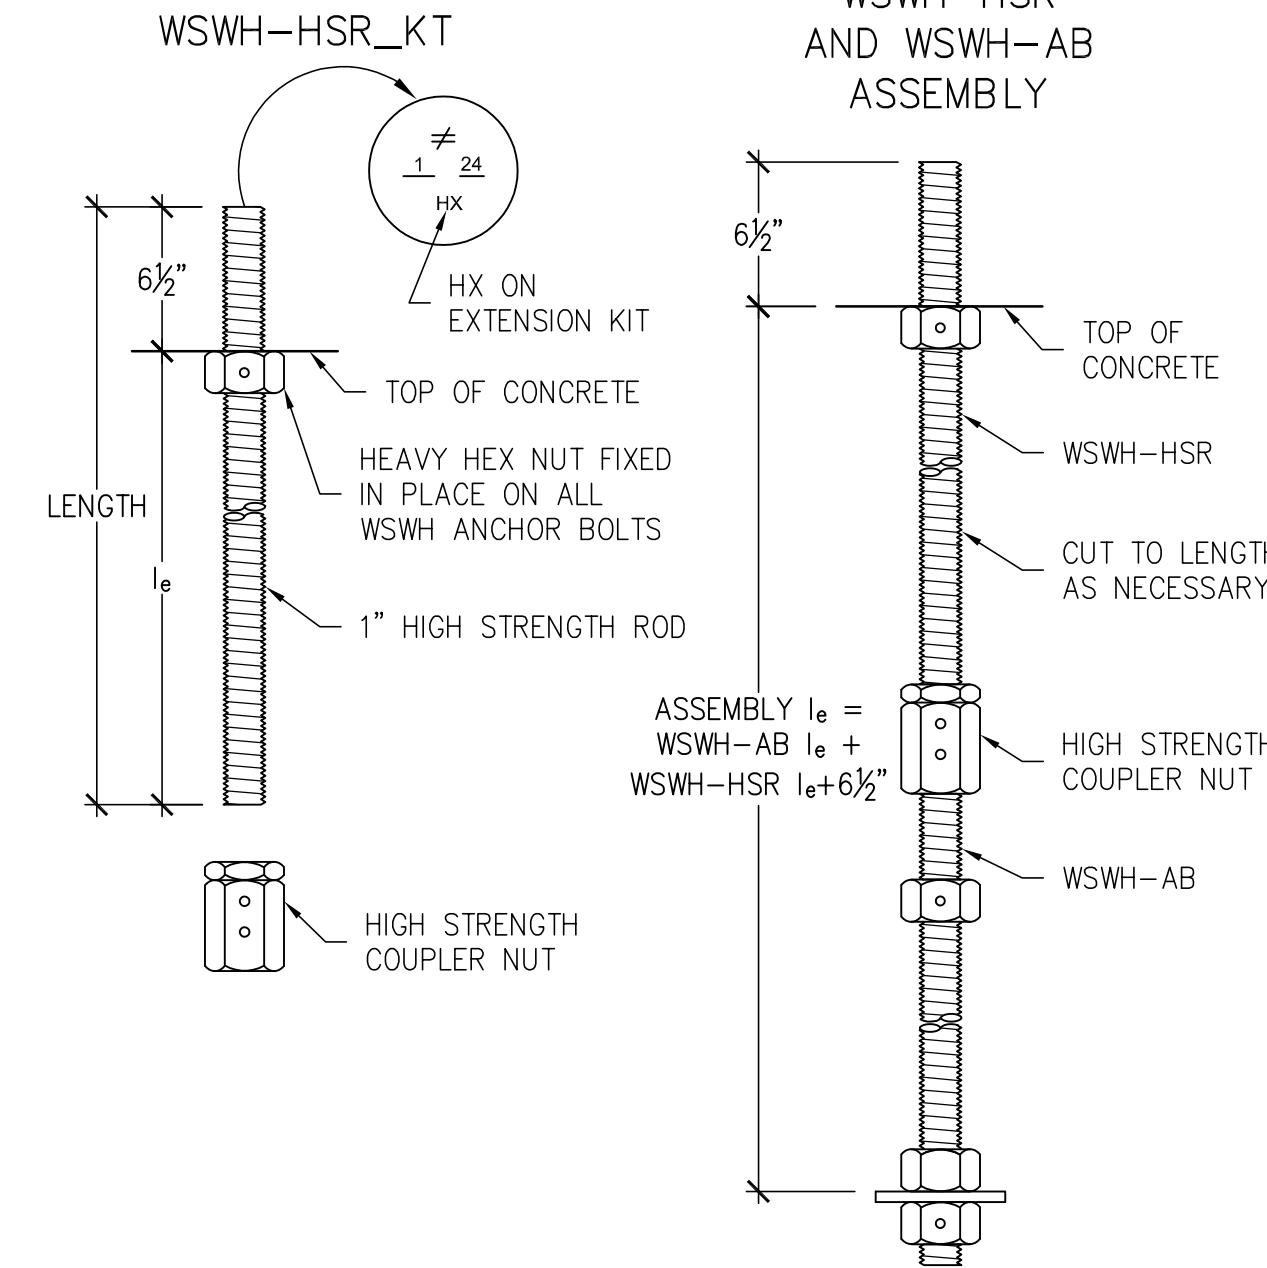


WSWH PANEL MODEL	MODEL NO.	DIAMETER	LENGTH	$l_e$
WSWH12, WSWH18 AND WSWH24	WSWH-HSR1x24KT	1"	24"	17 1/2"
	WSWH-HSR1x36KT	1"	36"	29 1/2"


WSWH-RT EXTERIOR INSTALLATION

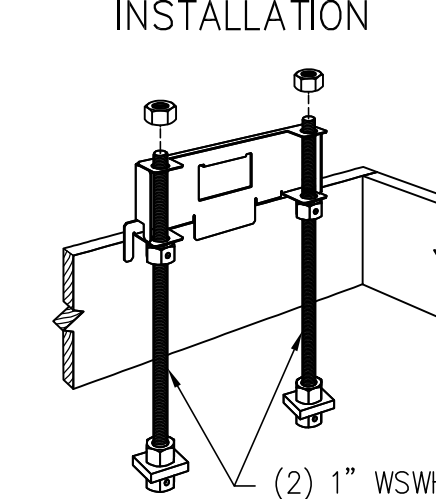


WSWH-RT INTERIOR INSTALLATION

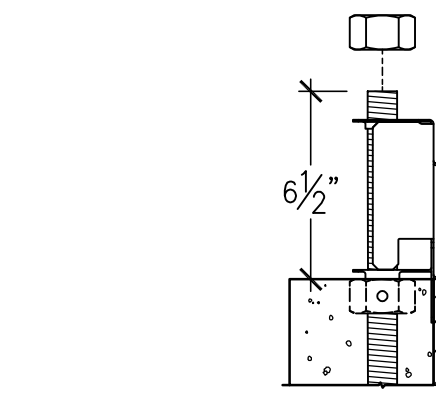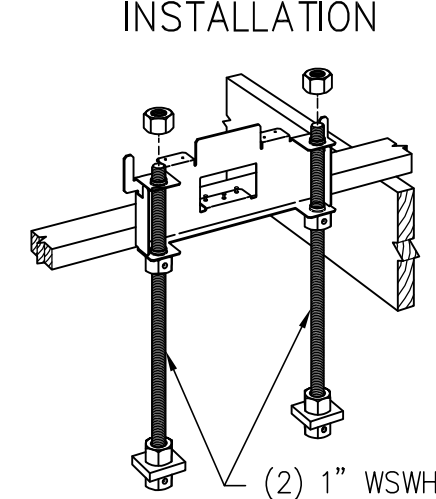

WSWH-RTBL BRICK LEDGE INSTALLATION

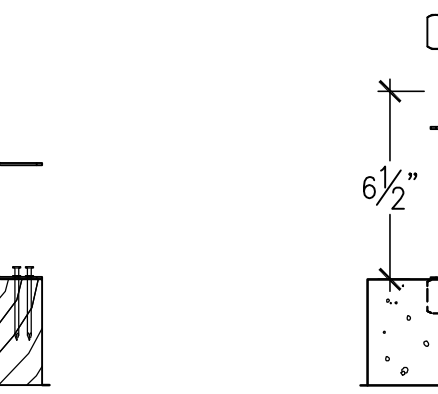

WSWH-RTPF PANEL FORM INSTALLATION

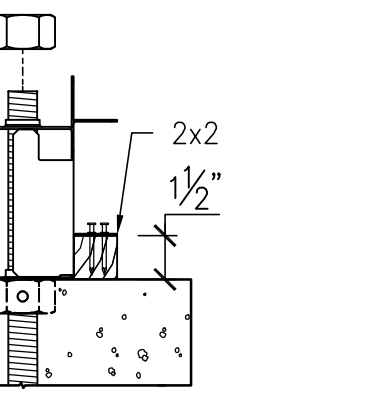

WSWH-RT WITH ANCHOR BOLT STABILIZERS

STRONG-WALL® WSWH ANCHORAGE – TYPICAL SECTIONS

1

WSWH ANCHOR BOLTS


3

WSWH ANCHOR BOLT EXTENSION

4

WSWH ANCHOR BOLT TEMPLATES

6

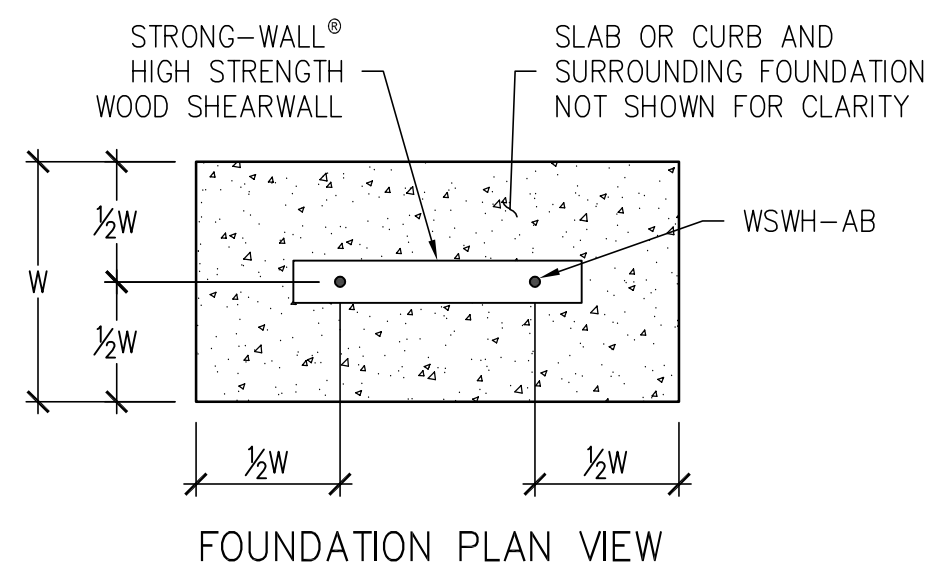

FOUNDATION PLAN VIEW

- NOTES:
- ANCHORAGE DESIGNS CONFORM TO ACI 318-11 APPENDIX D, ACI 318-14 CHAPTER 17 AND ACI 318-19 CHAPTER 17 WITH NO SUPPLEMENTARY REINFORCEMENT FOR CRACKED OR UNCRACKED CONCRETE AS NOTED.
  - ANCHOR STRENGTH INDICATES REQUIRED GRADE OF WSWH-AB ANCHOR BOLT. STANDARD (ASTM F1554 GRADE 36) OR HIGH STRENGTH (HS) (ASTM A193 GRADE B7).
  - SEISMIC INDICATES SEISMIC DESIGN CATEGORY C-F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-11 SECTION D.3.3.4.3, ACI 318-14 SECTION 17.2.3.4.3 AND ACI 318-19 SECTION 17.10.5.3.
  - WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C.
  - FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE DESIGNER MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
  - REFER TO 1/WSWH1 FOR  $d_e$ .

WSWH ANCHORAGE SOLUTIONS FOR 2500 PSI CONCRETE


DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	WSWH-AB1 ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbs)	W (in)	$d_e$ (in)
SEISMIC	CRACKED	STANDARD	16,000	33	11
			17,100	35	12
			34,100	52	18
	HIGH STRENGTH		36,800	55	19
			15,700	28	10
			17,100	30	10
UNCRAKED	STANDARD		33,500	45	15
			36,800	48	16
			6,200	16	6
	CRACKED	STANDARD	11,400	24	8
			17,100	32	11
			21,100	36	12
HIGH STRENGTH		27,300	42	14	
		34,100	48	16	
		36,800	51	17	
WIND	CRACKED	STANDARD	6,400	14	6
			12,500	22	8
			17,100	28	10
	HIGH STRENGTH		22,900	33	11
			28,400	36	12
			34,200	42	14
UNCRAKED	STANDARD		36,800	44	15

WSWH ANCHORAGE SOLUTIONS FOR 3000 PSI CONCRETE


DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	WSWH-AB1 ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbs)	W (in)	$d_e$ (in)
SEISMIC	CRACKED	STANDARD	16,000	31	11
			17,100	33	11
			33,900	49	17
	HIGH STRENGTH		36,800	52	18
			16,300	27	9
			17,100	28	10
UNCRAKED	STANDARD		34,000	43	15
			36,800	46	16
			5,600	14	6
	CRACKED	STANDARD	10,200	21	7
			17,100	30	10
			20,000	33	11
HIGH STRENGTH		26,500	39	13	
		33,600	45	15	
		36,800	48	16	
WIND	CRACKED	STANDARD	6,200	13	6
			12,800	21	7
			17,100	26	9
	HIGH STRENGTH		21,800	30	10
			28,900	36	12
			33,100	39	13
UNCRAKED	STANDARD		36,800	42	14

WSWH ANCHORAGE SOLUTIONS FOR 4500 PSI CONCRETE


DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	WSWH-AB1 ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbs)	W (in)	$d_e$ (in)
SEISMIC	CRACKED	STANDARD	16,000	27	9
			17,100	29	10
			34,700	44	15
	HIGH STRENGTH		36,800	46	16
			15,700	23	8
			17,100	25	9
UNCRAKED	STANDARD		33,900	38	13
			36,800	40	14
			6,800	14	6
	CRACKED	STANDARD	11,600	20	7
			17,100	26	9
			21,400	30	10
HIGH STRENGTH		28,400	36	12	
		32,400	39	13	
		36,800	43	15	
WIND	CRACKED	STANDARD	6,800	12	6
			12,400	18	6
			17,100	23	8
	HIGH STRENGTH		22,800	27	9
			28,700	30	10
			30,700	33	11
UNCRAKED	STANDARD		36,800	37	13

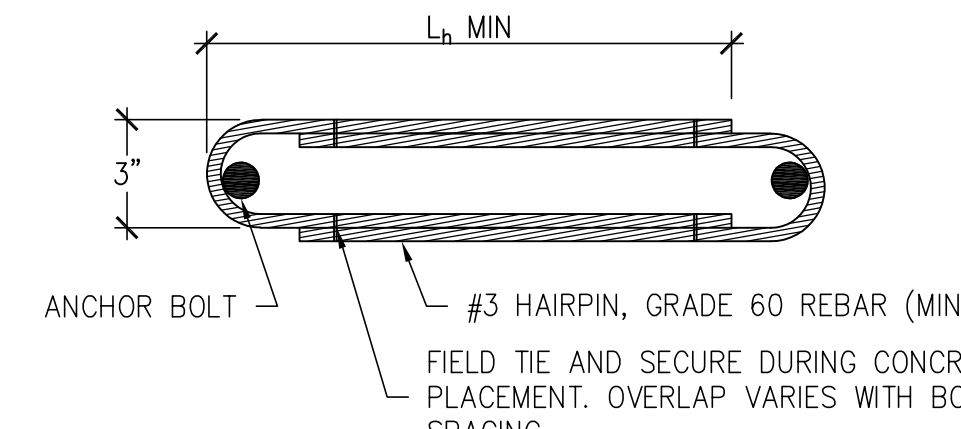

HAIRPIN SHEAR REINFORCEMENT

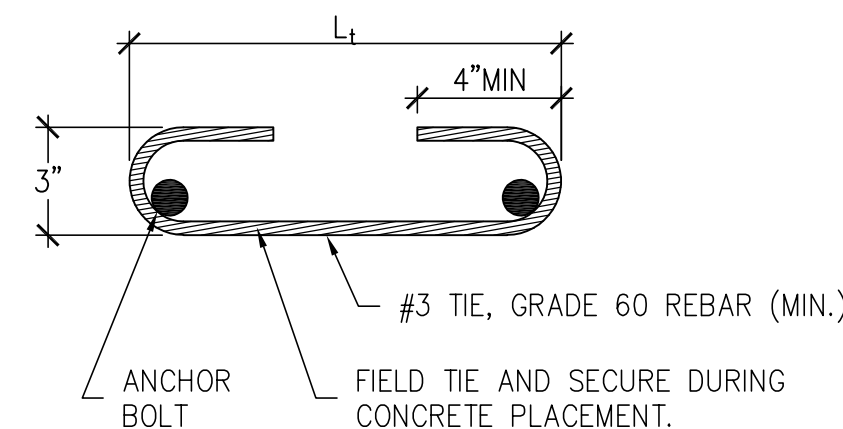


TIE SHEAR REINFORCEMENT

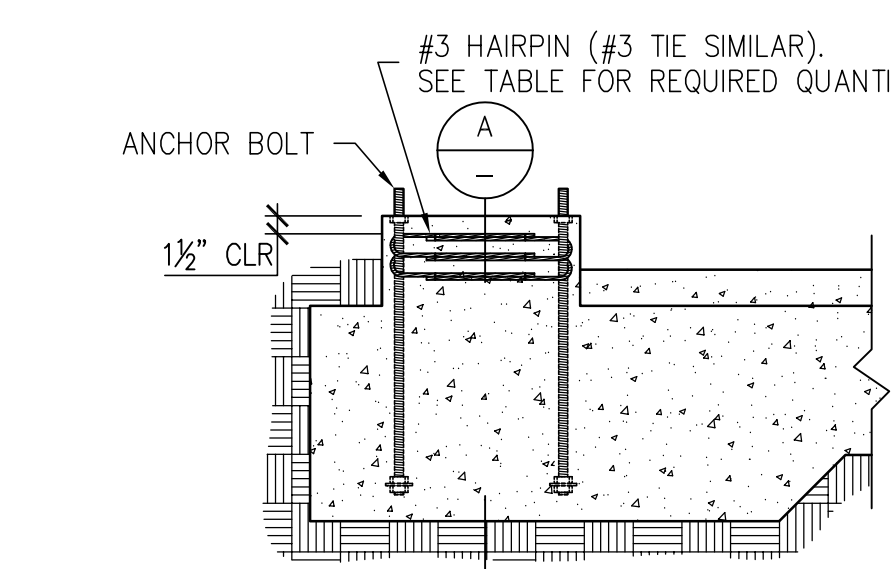

HAIRPIN INSTALLATION

(GARAGE CURB SHOWN. OTHER FOOTING TYPES SIMILAR.)

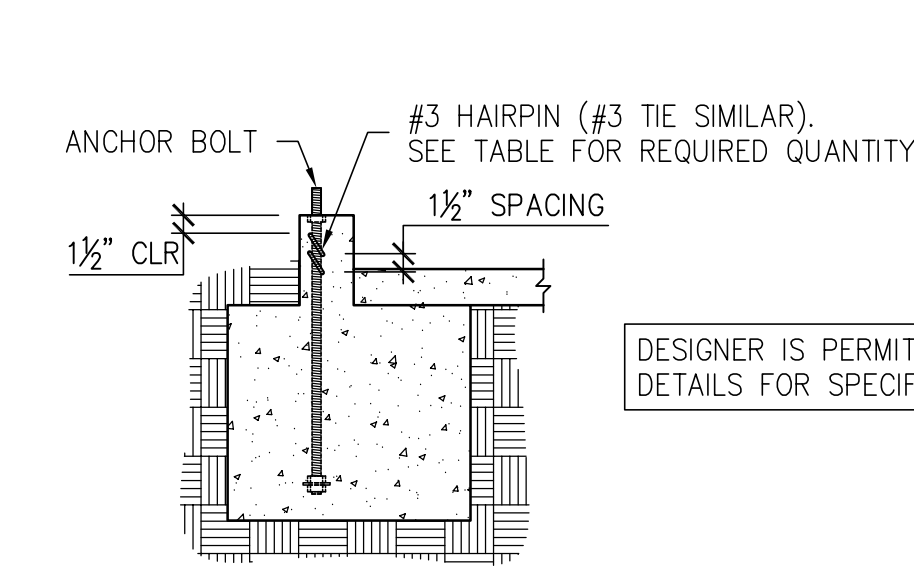

SECTION A

DESIGNER IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.

MODEL	STRONG-WALL® HIGH STRENGTH WOOD SHEARWALL SHEAR ANCHORAGE				ASD ALLOWABLE SHEAR LOAD, V (lb.)		
	$l_e$ OR $l_b$ (in.)	SHEAR REINFORCEMENT	MIN. CURB/STEMWALL WIDTH (in.)	SHEAR REINFORCEMENT	MIN. CURB/STEMWALL WIDTH (in.)	UNCRAKED	CRACKED
						SEISMIC <sup>3</sup>	WIND <sup>4</sup>
WSWH12	10 1/4	(1) #3 TIE	6	SEE NOTE 7	6	1,080	770
WSWH18	15	(2) #3 HAIRPINS <sup>5,6</sup>	6	(1) #3 HAIRPIN	6	HAIRPIN REINF. ACHIEVES MAX. ALLOW SHEAR LOAD OF THE WSWH	
WSWH24	19	(2) #3 HAIRPINS <sup>5</sup>	6	(2) #3 HAIRPINS <sup>5</sup>	6		

- NOTES:
- SHEAR ANCHORAGE DESIGNS CONFORM TO ACI 318-19, ACI 318-11 AND ACI 318-14 AND ASSUME MINIMUM 2,500 PSI CONCRETE.
  - SHEAR REINFORCEMENT IS NOT REQUIRED FOR INTERIOR FOUNDATION APPLICATIONS (PANEL INSTALLED AWAY FROM EDGE OF CONCRETE), OR BRACED WALL PANEL APPLICATIONS.
  - SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC SHEAR REINFORCEMENT DESIGNS CONFORM TO ACI 318-19, SECTION 17.10.6.3, ACI 318-14, SECTION 17.2.3.5.3.
  - WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B.
  - ADDITIONAL TIES MAY BE REQUIRED AT GARAGE CURB OR STEMWALL INSTALLATIONS BELOW ANCHOR REINFORCEMENT PER DESIGNER.
  - USE (1) #3 HAIRPIN FOR WSWH12 WHEN STANDARD STRENGTH ANCHOR IS USED.
  - USE (1) #3 TIE FOR WSWH12 WHEN PANEL DESIGN SHEAR FORCE EXCEEDS TABULATED ANCHORAGE ALLOWABLE SHEAR LOAD.
  - #4 GRADE 40 SHEAR REINFORCEMENT MAY BE SUBSTITUTED FOR WSWH SHEAR ANCHORAGE SOLUTIONS.
  - CONCRETE EDGE DISTANCE FOR ANCHORS MUST COMPLY WITH ACI 318-19 SECTION 17.9.2, ACI 318-14 SECTION 17.7.2 AND ACI 318-11 SECTION D.8.2.
  - THE DESIGNER MAY SPECIFY ALTERNATE SHEAR ANCHORAGE.

STRONG-WALL® HIGH STRENGTH WOOD SHEARWALL TENSION ANCHORAGE SCHEDULE 2,500, 3,000 AND 4,500 PSI

2

STRONG-WALL® WSWH SHEAR ANCHORAGE SCHEDULE AND DETAILS

5

NO.	DATE	REVISIONS
0	02-26-2021	FIRST RELEASE - 2018 IBC
1	03-16-2021	2021 IBC REVISIONS

SIMPSON Strong-Tie, Co. Inc.  
 • 5956 W. Las Positas Blvd.  
 Pleasanton, CA 94588  
 • Tel: (800) 999-5099  
 • Website: www.strongtie.com



STRONG-WALL® WSWH ANCHORAGE DETAILS ENGINEERED DESIGNS



NAME	DATE
	03-16-2021
SCALE	N.T.S.
CHECKED	
SHEET	WSWH1
OF SHEETS	
JOB NO.	